EXAMPLE OF DOSING BY DISCHARGE AT TWO SPEEDS WITH SMART

Once are configured all the basic parameters of the device (SCALE DEF, OPTIONS, MASS CALIB. or mV CALIB.), we will configure the DIGITAL OUTPUTS menu, where we set the setpoint for the dosing. Afterwards we will configure the DIGITAL INPUTS menu where we will define the start and the end of the dosing.

Finally we will show the connection ways for the SMART digital inputs and outputs, via SUB-D 25 connector or via cable glands for the SMART IP-65 version.

Starting from the following example of dosing:
We have got two 250kg load cells capacity and we want to perform a 300kg scale with a 100gr division.
We will make 5, 10, 15 and 20kg pots.
The SCALE DEF menu will be configured as follows:

FUNCT: INDICA
BIRANGE: OFF (Multirange deactivated)
CAP: 300 Kg (Maximum capacity of the scale)
D1: 1 (Value of the scale division)
DP: 0,1 (Decimal point position)
0-TRACK: 0,5d (Zero follower band)

0-TOP: 1,9 (Allowed limit to the $\overset{\blacktriangleleft}{\text{0}}$ key)
0-START: OFF (Auto zeroes when it is turned on)
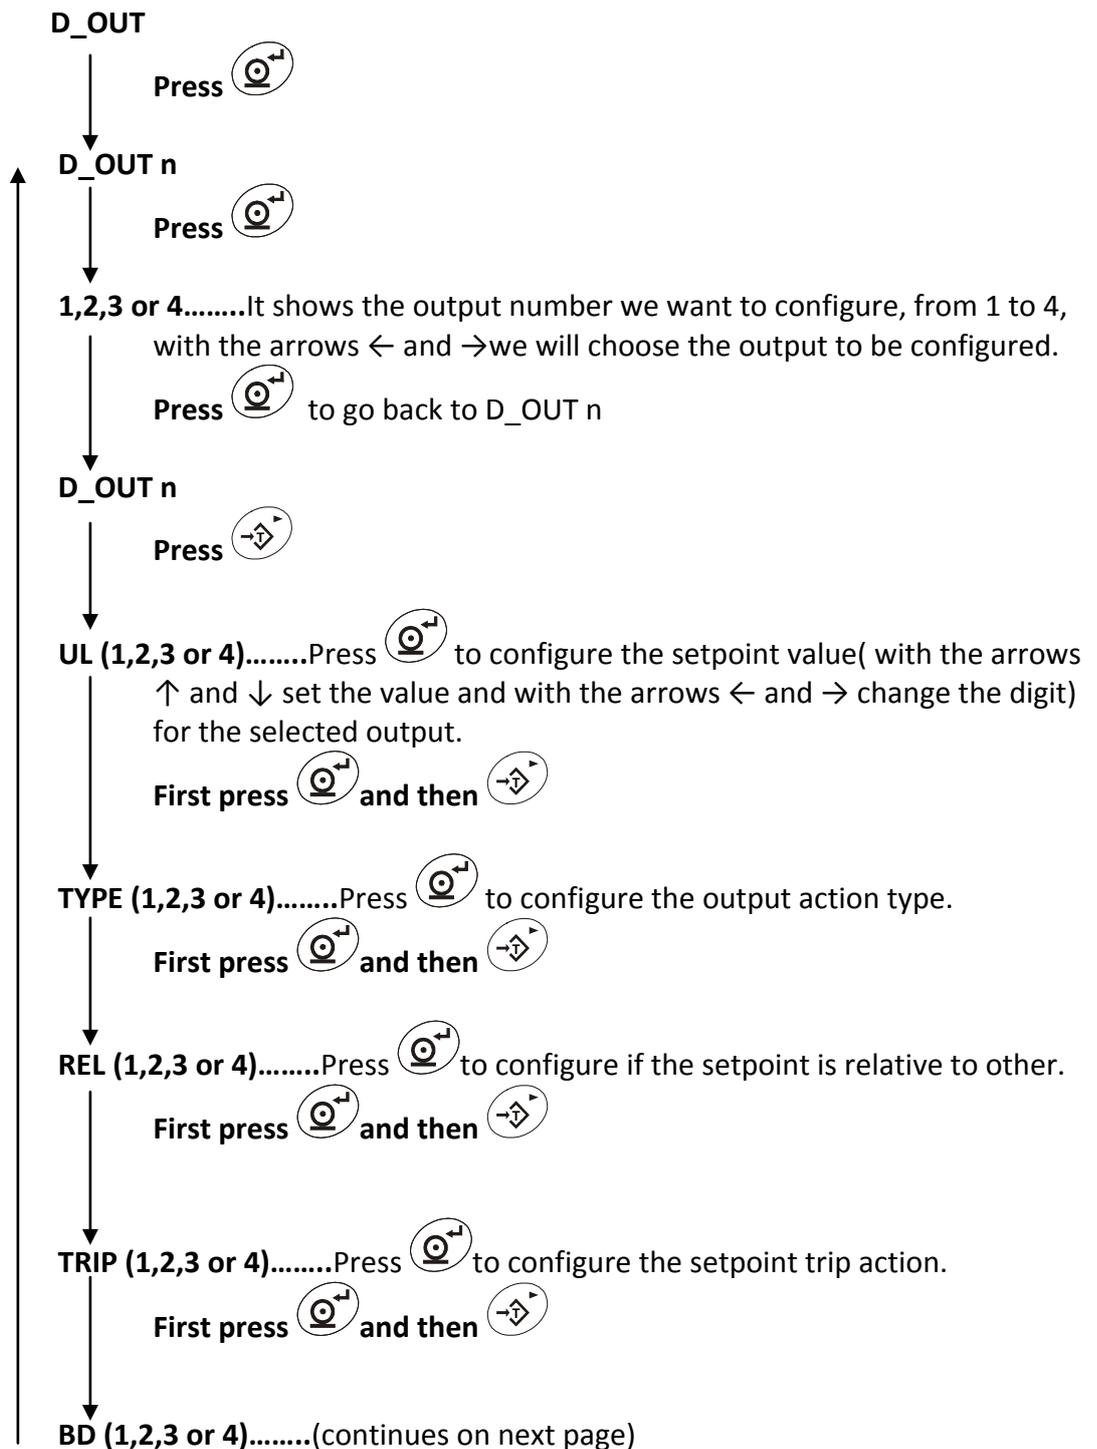**0-NEG:** OFF (Auto zeroes if negative weight)
UNIT: Kg (Units)

VALUES THAT WE SHOULD SET IN D_OUTs TO PERFORM THE DOSING BY DISCHARGE AT TWO SPEEDS ACCORDING TO THE EXAMPLE (5kg pot)

D_OUT n	1	2	3	4
UL	0	5,0	0	2,0
TYPE	NET	N_REL	N_REL	P_REL
REL	1	1	2	2
TRIP	H	L	H	L
BD	0	0	0	0
HY	0	0,2	0	0
D.LOC	ON	OFF	ON	OFF
OUTPUT	OFF	2	3	4

D_OUT's CONFIGURATION MENU

Press (EXIT) + (→0←) (first press EXIT and hold and press →0←) the device will ask us for the PIN code, to configure this menu is not necessary because we will not change protected parameters, press (⊙) and get into the configuration menu, then press 5 times (→) key, now we are in **D_OUT** menu.

D_OUT

   Press (⊙)

D_OUT n

   Press (⊙)

1,2,3 or 4…….. It shows the output number we want to configure, from 1 to 4, with the arrows ← and →we will choose the output to be configured.

   Press (⊙) to go back to D_OUT n

D_OUT n

   Press (→)

UL (1,2,3 or 4)…….. Press (⊙) to configure the setpoint value(with the arrows ↑ and ↓ set the value and with the arrows ← and → change the digit) for the selected output.

   First press (⊙) **and then** (→)

TYPE (1,2,3 or 4)…….. Press (⊙) to configure the output action type.

   First press (⊙) **and then** (→)

REL (1,2,3 or 4)…….. Press (⊙) to configure if the setpoint is relative to other.

   First press (⊙) **and then** (→)

TRIP (1,2,3 or 4)…….. Press (⊙) to configure the setpoint trip action.

   First press (⊙) **and then** (→)

BD (1,2,3 or 4)……..(continues on next page)

BD (1,2,3 or 4)…….. Press ⊙ and set the band where the parameter trip actuates, parameter only valid for selections of IN_B and OUT_B of TRIP.

First press ⊙ **and then** ⊡

HY (1,2,3 or 4)…….. Press ⊙ to set the hysteresis value which prevents the chattering of the digital output.

First press ⊙ **and then** ⊡

D_LOC (1,2,3 or 4)…….. Press ⊙ to block the modification of VL(i) value through the keyboard.

First press ⊙ **and then** ⊡

OUTPUT (1,2,3 or 4)…….. Press ⊙ and set the physical output where the setpoint will actuate.

First press ⊙ **and then** ⊡

D_OUT n

Press twice ⊙ to get out from the configuration menu.

Weight mode

IMPORTANT: We should keep in mind that surely we will have to change the setpoint value, I mean, we have to set a lower value because of the gap between the closing of the relay, the in flight material and the weight of the scale.
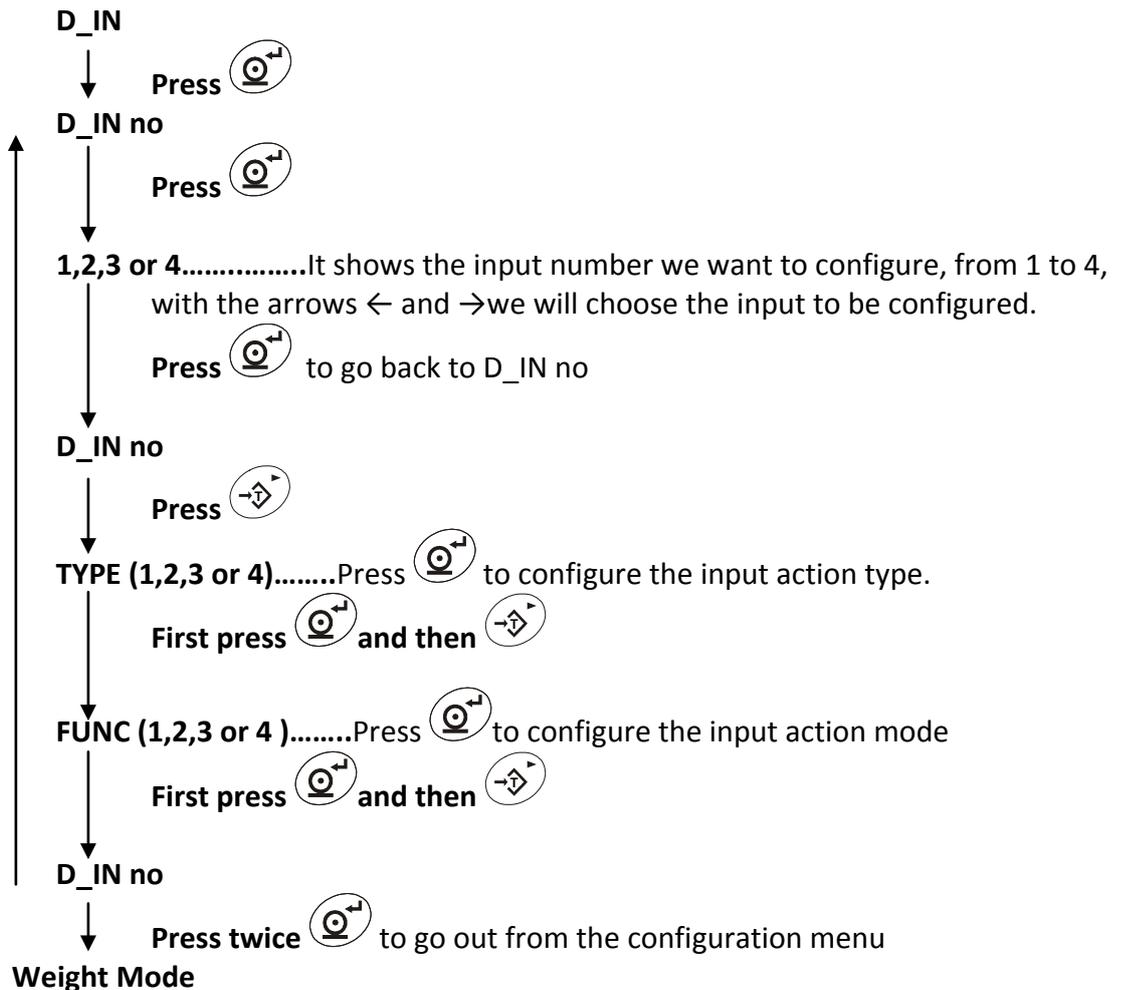
Now to finish we should set the digital input menu, where we will frame the dosage maneuver.

VALUES THAT WE SHOULD SET IN THE D_IN (Digital Inputs) TO PERFORM THE DOSING AT TWO SPPEDS ACCORDING TO THE EXAMPLE

D_IN n	1	2
TYPE	TARE	C.TARE
FUNC	H	H

D_IN's CONFIGURATION MENU

Press ⟨EXIT⟩ + ⟨→0←⟩ (first EXIT and hold and then press →0←)the device will ask us for the PIN code, to set that menu is not necessary to introduce the PIN code, because we are not going to change any protected parameter, press ⟨◎⟩and go into the configuration menu, press ⟨→⟩ **6** times and now we are in **D_IN** menu.

D_IN
↓ **Press** ⟨◎⟩
D_IN no
↓ **Press** ⟨◎⟩
↓
1,2,3 or 4……………..It shows the input number we want to configure, from 1 to 4, with the arrows ← and →we will choose the input to be configured.
Press ⟨◎⟩ to go back to D_IN no
↓
D_IN no
↓ **Press** ⟨→⟩
↓
TYPE (1,2,3 or 4)……...Press ⟨◎⟩to configure the input action type.
First press ⟨◎⟩**and then** ⟨→⟩
↓
FUNC (1,2,3 or 4)……...Press ⟨◎⟩to configure the input action mode
First press ⟨◎⟩**and then** ⟨→⟩
↓
D_IN no
↓ **Press twice** ⟨◎⟩ to go out from the configuration menu
**Weight Mode**

Once are configured the D_OUT and the D_IN, we should perform the following wiring:

The D_OUT 3 will be used to end the maneuver, I mean, we will connect the D_OUT 3 output to the D_IN 2 input, in this way, we will frame the maneuver. When the device will reach the setpoint, it will perform a C.TARE (Clear Tara) automatically to finish the maneuver.

It's shown below the two possible examples of connection, or a SUB-D 25 female connector or a SMART IP-65 (with cable glands).

Multi option wiring connection for the digital inputs and outputs with a SUB-D 25 female connector

	DIGITAL INPUTS	
SUB-D 25 aerial female connector Pin allocation welding's side view	PIN	SIGNAL
	5	IN1
	18	IN2
	6	IN3
	19	IN4
	4	GND
	DIGITAL OUPTUS	
	PIN	SIGNAL
	9	Vext
	10	D-OUT1
	22	D-OUT2
	11	D-OUT3
	23	D-OUT4
	4	GND

The SUB-D 25 female connector it should be connected as follows:
Pin 11(D_OUT3) with pin 18(IN2) to frame the dosage maneuver.

Wiring diagram for a SMART-IP65 multi option

For a SMART IP-65 the wiring connection of the digital inputs and outputs must be performed as follows.
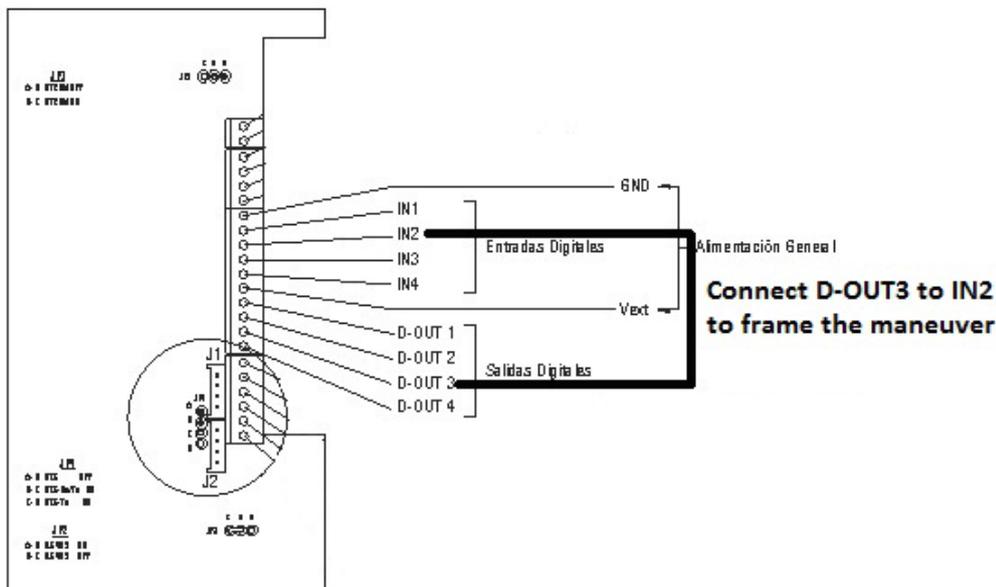
We should perform a bridge between D-OUT3 and IN2 terminal, to frame the dosage maneuver, as shown in the figure.

4 Digital Inputs/4 Relay outputs accessory

Accessory necessary if you want to have 4 digital relay outputs, because with SMART Multi 1 or Multi 2 there are already 4 digital outputs, but these outputs aren't to relay are Open Collector transistors.